






ACCESS DOORS REMOVED FOR CLARITY



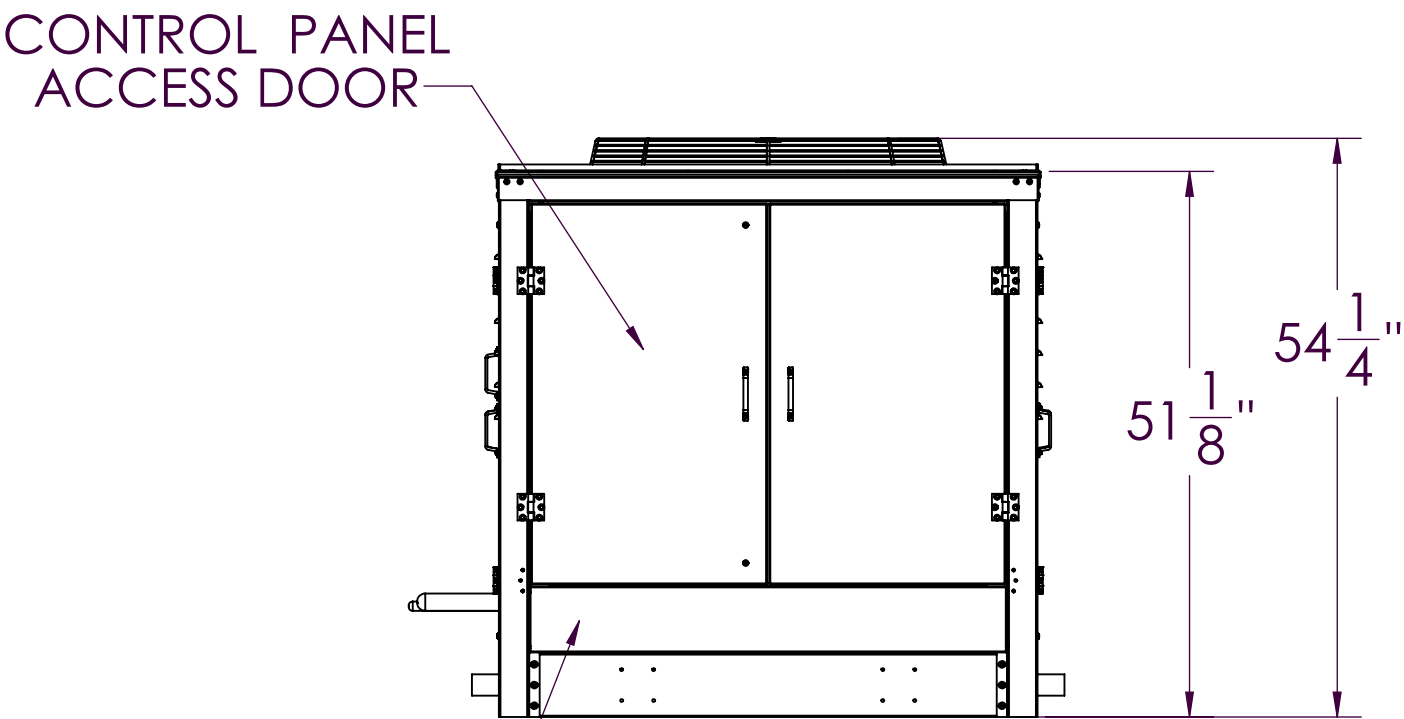

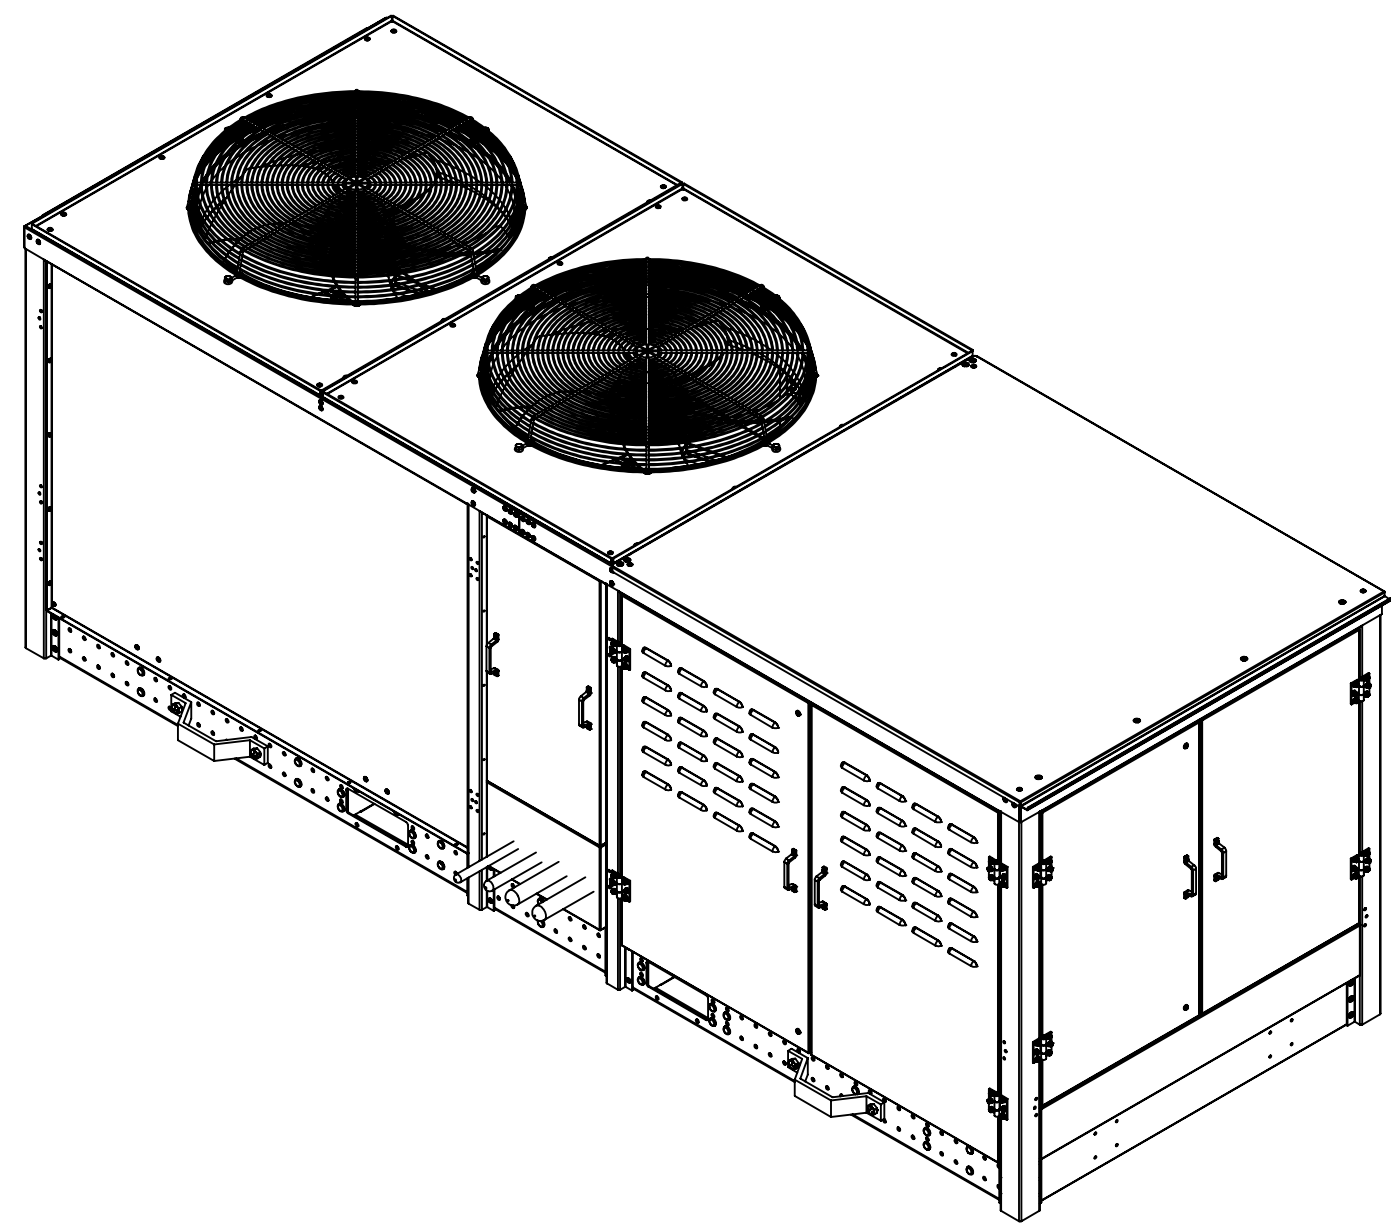

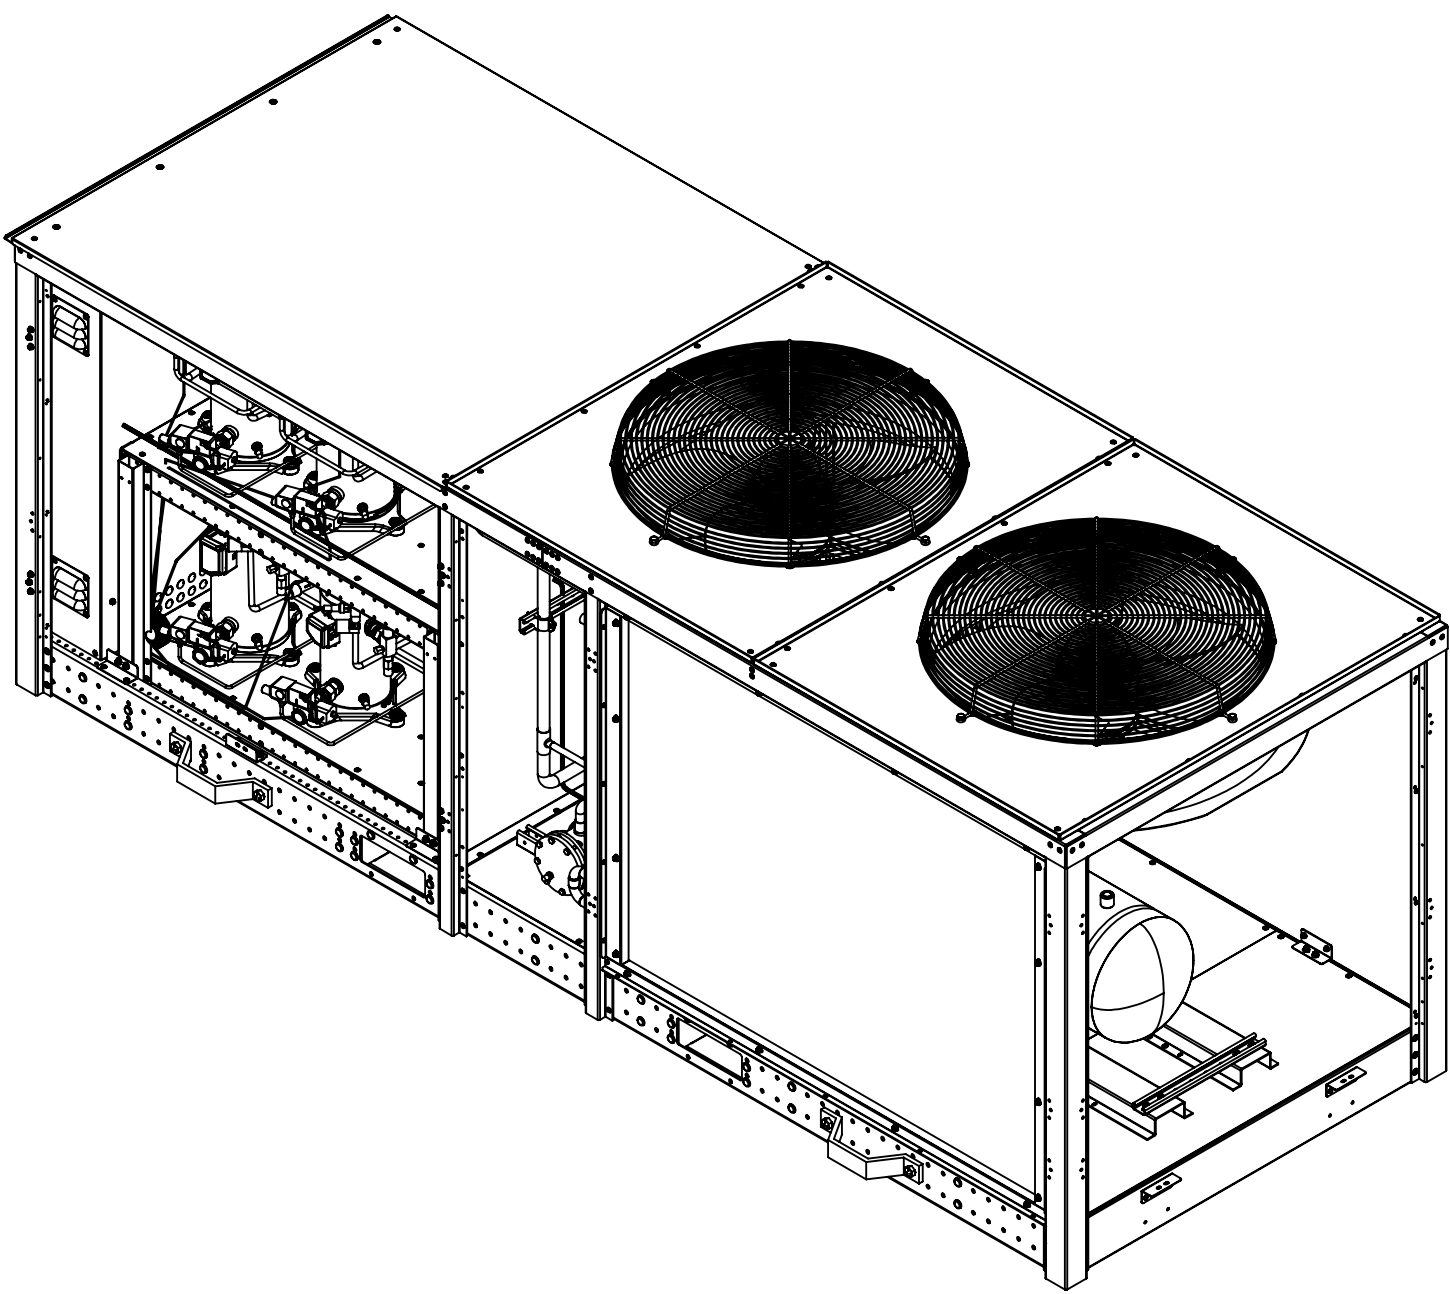

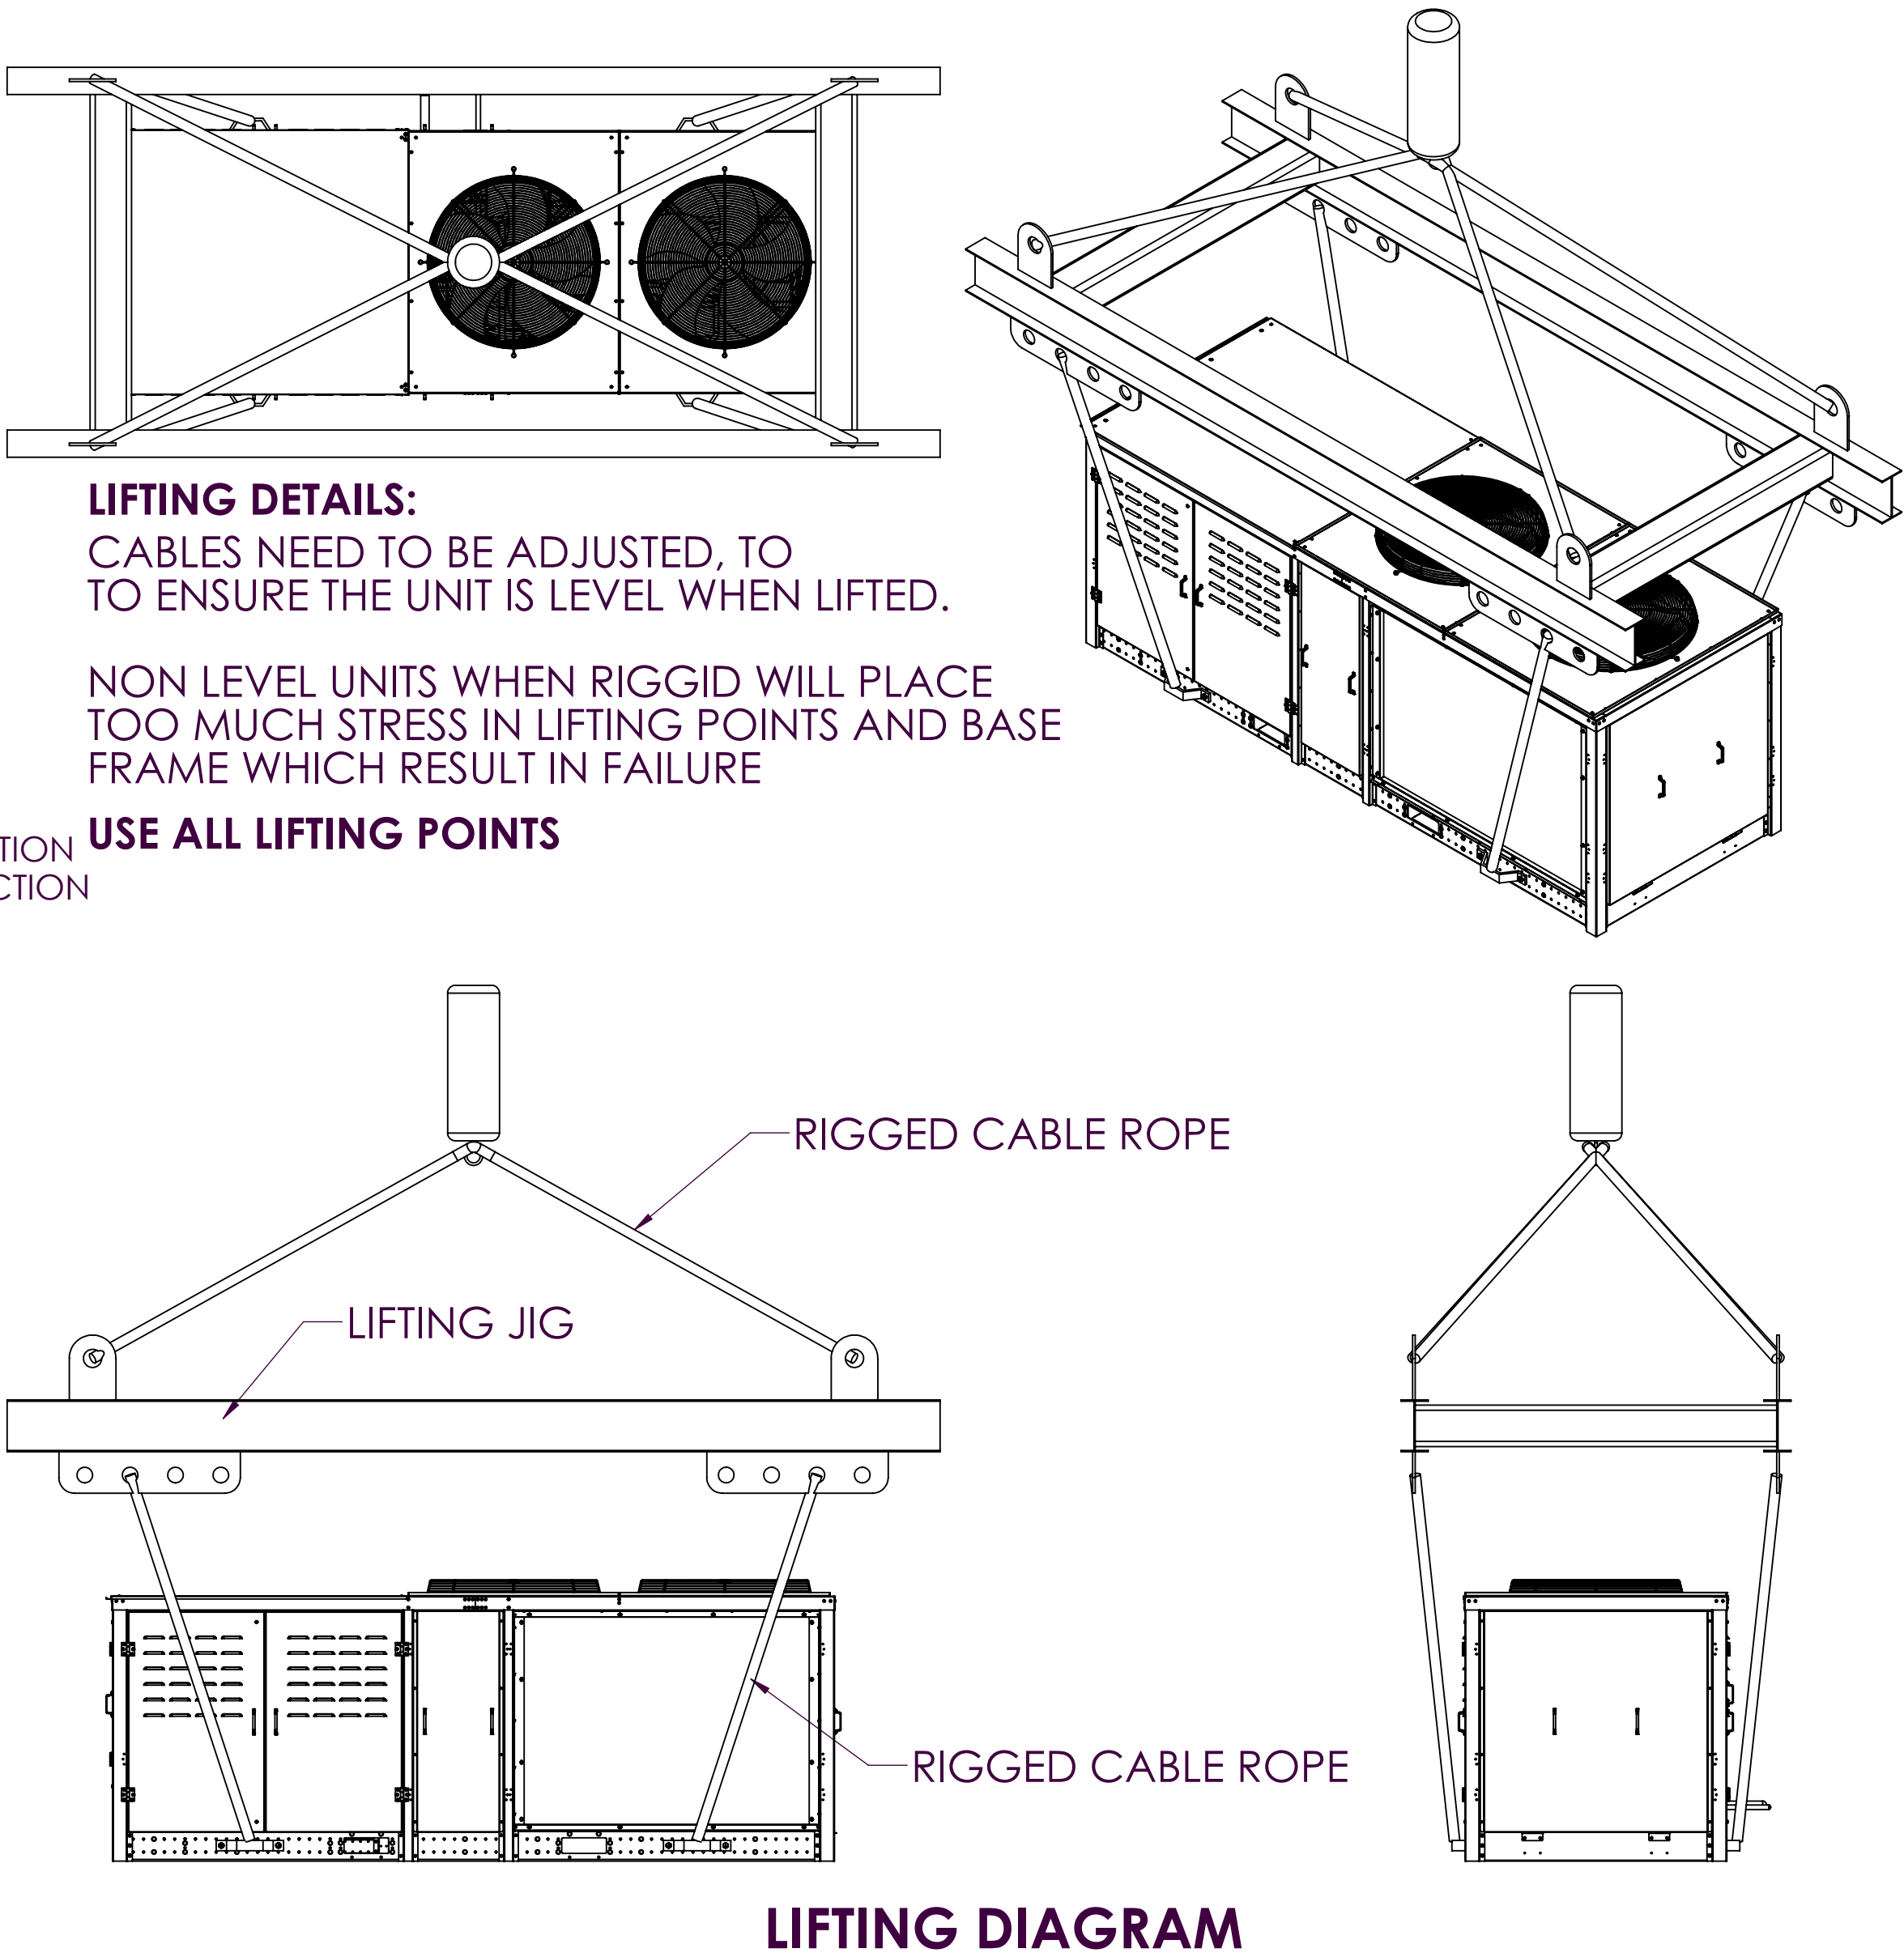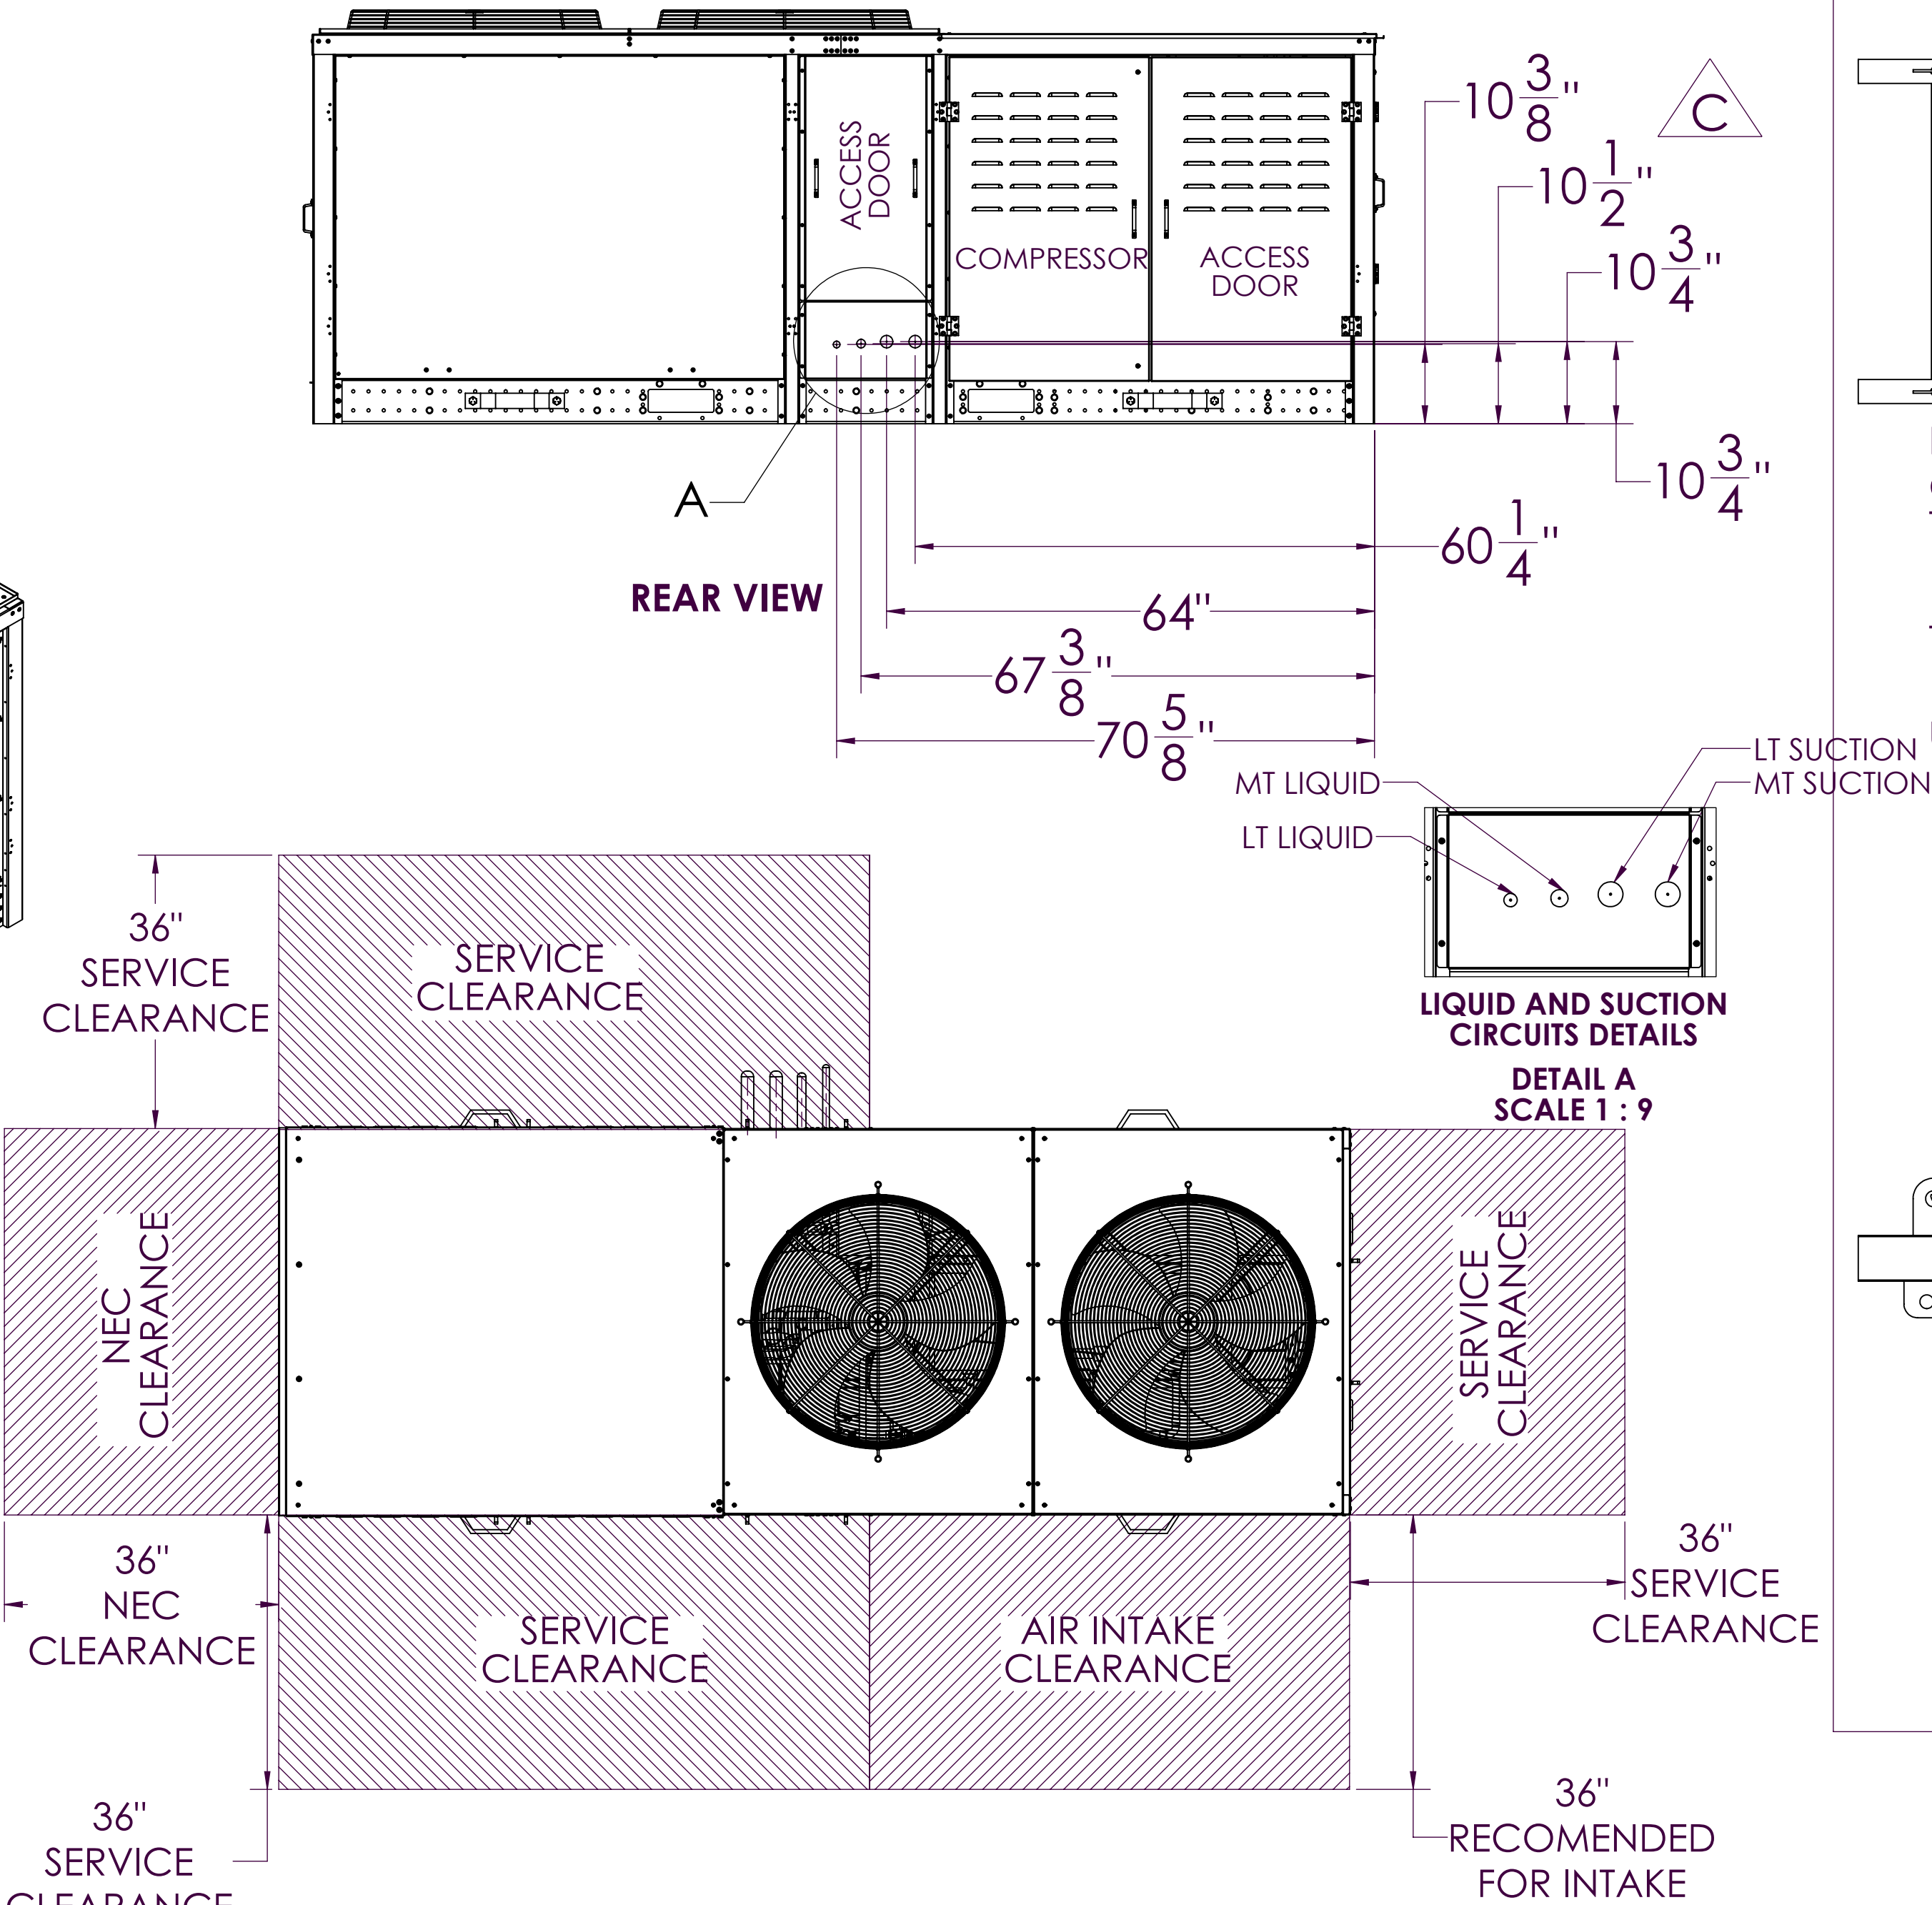ELECTRICAL INPUT ACCESS

NOTE:

1. ADAPTAPAK UNIT FLOOR IS NOT DESIGNED TO BE WEATHER TIGHT AND IS RECOMMENDED TO SIT ON STEEL DUNNAGE ABOVE THE FINISHED ROOF.
2. REFRIGERATION STUBS ARE ONLY AVAILABLE AS SIDE ACCESS AS SHOW.



MODEL	WEIGHT (LBS)	SUCTION LOOP		LIQUID LOOP		MCA @208V	MOPD @208V
		LT	MT	LT	MT		
ADP-M0048-L0012	2800	7/8	1-5/8	1/2	1-1/8	64.3	80.0
ADP-M0079-L0012	2800	7/8	1-5/8	1/2	1-1/8	77.9	100.0
ADP-M0048-L0032	2800	1-5/8	1-5/8	7/8	1-1/8	86.8	100.0

REVISION RECORD				ALL TOLERANCES UNLESS OTHERWISE SPECIFIED	P/N: AS00076402-SUBMITTAL	DRAWN BY: SMA (SEE REVISIONS)
REV	DATE	BY	DESCRIPTION	ALL BENDS 90° DEGREES ± 1° ALL FRACTIONAL DIM. ± 1/32 3 PLC DECIMALS ± .010 2 PLC DECIMALS ± .03 THIRD ANGLE PROJECTION DO NOT SCALE DRAWING	ASSY.2FAN,1COIL,DUAL SUCTION,APAK-SUBMITTAL  SYSTEMS - REFRIGERATION &  COMPANY 709 SIGHAN ROAD • CONYERS, GA 30013 PHONE: (770) 385-3100 • FAX: (770) 285-3076	DATE: 06MAY2017 SCALE: (EXCEPT AS NOTED) 1:12 SIZE: D SHEET: 1 of 1
	19/04/2017	SMA	CHANGED CLOSURE CLEARANCE TO SERVICE CLEARANCE			
	23/04/2017	BN	LIQUID AND SUCTION ORIFIT DETAILS ADDED			
	20/07/2017	...	ADDED COMPRESSOR VOLTAGE AND PIPING OUTLET DIMENSION			
				CAD FILE NAME: AS00076402-SUBMITTAL		

THIS DOCUMENT CONTAINS INFORMATION WHICH HILL PHOENIX CONSIDERS TO BE CONFIDENTIAL OR PROPRIETARY. ALL RIGHTS ARE RESERVED UNLESS OTHERWISE STATED HEREIN.