
#### **GENERAL NOTES:**

• "---" Indicates that the feature is not an option on this case model and/or the data is not yet available at this time.



SHIPPING WEIGHT					
Case	Weight				
HSO-SC					



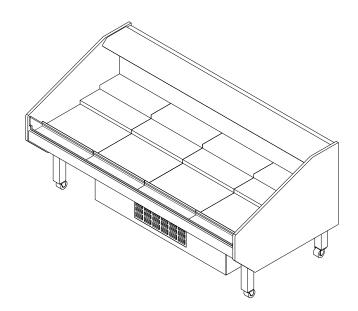



Intertek Intertek
ENGINEERED FOR STORES WITH AMBIENT
CONDITIONS NOT TO EXCEED 75° AND 55%
RELATIVE HUMIDITY. DUE TO ENGINEERING
IMPROVEMENTS SPECIFICATIONS MAY CHANGE
WITHOUT NOTICE. ALL MEASUREMENTS ARE
TAKEN PER ASHRAE-72-2005 SPECIFICATIONS.
HILLPHOENIX REFRIGERATED DISPLAY CASES
FOR SALE IN THE UNITED STATES MEET OR EXCEED
DEPARTMENT OF ENERGY 2017 REQUIREMENTS.
NUMBERS ARE BASED ON STANDARD CASE SIZES.
CONSULT ENGINEERING.

# **HSO-SC**

Rev. Date	Rev.#	Rev. Title
02-14-21	2	DATA UPDATE
02-02-21	1	NEW STANDARDS



SYSTEM REQUIREMENTS									
Case Length	Volts	Phase	Total Amps	Minimum Circuit Ampacity	Maximum Overcurrent Protection				
2'	120	1	10.52	14	15				
4'	120	1	11.85	15	20				
6'	120	1	19.15	24	25				
8'	120/208	1	15.41	19	20				

ELECTRI	ELECTRICAL DATA											
		High Efficiency		Anti-Condensate		Drain		Evaporator			Auxiliary	
	Fans		ns	Fans		Pumps		Pan Heaters			Fans	
Case	Per	120	Volts	120 \	√olts	120	Volts				120	Volts
Length	Case	Amps	Watts	Amps	Watts	Amps	Watts	Volts	Amps	Watts	Amps	Watts
2'	1	0.30	36					120	5.0	600		
4'	2	0.60	72					120	5.0	600		
6'	2	0.60	72					120	8.3	1000		
8'	3	0.90	108					208	4.2	1500		

LIGHTING DATA									
	Clearvoyant 4 LED Lig (Per Light Row)					nting			
	Lights			rd Power or Shelf)	High Power (Cornice)				
Case	Per	Light	120	120 Volts		Volts			
Length	Row	Length	Amps	Watts	Amps	Watts			
2'	1	2'	0.03	3.1	0.06	7.8			
4'	1	4'	0.05	5.9	0.12	14.9			
6'	2	3'	0.08	9.4	0.20	23.8			
8'	2	4'	0.10	11.8	0.24	29.8			

GUIDELINES AND CONTROL SETTINGS								
24hr Energy Usage (kWh/ft)	Suction Temperature @ Case Outlet (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Discharge Air Velocity (FPM)				
	+20	10 - 12	32 - 36	220				

#### NOTES:

- "---" Indicates that the feature is not an option on this case model and/or the data is not yet available at this time.
- Listed discharge air velocity represents the average velocity at the peak of defrost.
- · RLA Running Load Amps
- LRA Locked Rotor Amps







Intertek Intertek
ENGINEERED FOR STORES WITH AMBIENT
CONDITIONS NOT TO EXCEED 75° AND 55%
RELATIVE HUMIDITY. DUE TO ENGINEERING
IMPROVEMENTS SPECIFICATIONS MAY CHANGE
WITHOUT NOTICE. ALL MEASUREMENTS ARE
TAKEN PER ASHRAE-72-2005 SPECIFICATIONS.
HILLPHOENIX REFRIGERATED DISPLAY CASES
FOR SALE IN THE UNITED STATES MEET OR EXCEED
DEPARTMENT OF ENERGY 2017 REQUIREMENTS.
NUMBERS ARE BASED ON STANDARD CASE SIZES.
CONSULT ENGINEERING.

# HSO-SC

Rev. Date	Rev.#	Rev. Title
02-14-21	2	DATA UPDATE
02-02-21	1	NEW STANDARDS



# **HSO-SC**

CONDEN	CONDENSING UNIT DATA										
Case				RLA	LRA		Condens	ser Fans	Lbs. of		
Length	Volts	Phase	HP	(Amps)	(Amps)	Refrig.	Amps	Watts	Refrig.		
2'	115	1	1/4	4.8	34	404a	0.36	41	2.0		
4'	115	1	1/2	7.5	42	404a	0.53	61	2.6		
6'	115	1	3/4	15.0	70	404a	1.70	170	4.2		
8'	208	1	3/4	9.0	43	404a	0.82	135	5.1		

DEFROS	DEFROST CONTROLS									
			Electric Defrost		Timed-Off Defrost		Hot Gas Defrost			
		Run-Off	Termination			Termination		Termination		
Case	Defrosts	Time	Fail-Safe	Temp	Fail-Safe	Temp	Fail-Safe	Temp		
Length	Per Day	(Min)	(Min)	(°F)	(Min)	(°F)	(Min)	(°F)		
2'	4				45	42				
4'	4				45	42				
6'	4				45	42				
8'	4				45	45				









ENGINEERED FOR STORES WITH AMBIENT CONDITIONS NOT TO EXCEED 75° AND 55% RELATIVE HUMIDITY. DUE TO ENGINEERING IMPROVEMENTS SPECIFICATIONS MAY CHANGE WITHOUT NOTICE. ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS. NUMBERS ARE BASED ON STANDARD CASE SIZES. CONSULT ENGINEERING.

# HSO-SC

Rev. Date	Rev.#	Rev. Title
02-14-21	2	DATA UPDATE
02-02-21	1	NEW STANDARDS



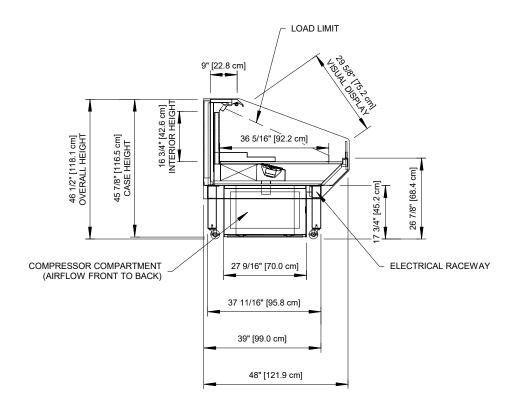

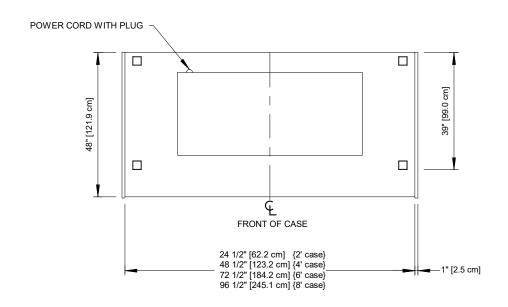







ENGINEERED FOR STORES WITH AMBIENT CONDITIONS NOT TO EXCEED 75° AND 55% RELATIVE HUMIDITY. DUE TO ENGINEERING IMPROVEMENTS SPECIFICATIONS MAY CHANGE WITHOUT NOTICE. ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS. NUMBERS ARE BASED ON STANDARD CASE SIZES. CONSULT ENGINEERING.

#### **HSO-SC**

Rev. Date	Rev.#	Rev. Title
02-14-21	2	DATA UPDATE
02-02-21	1	NEW STANDARDS



Clearvayant