
02.5UM-NRG

GENERAL NOTES:

- "---" indicates that the feature is not an option with this case model and/or the data is not available at this time.
- · LED lights only.
- · Maximum of 3 rows of standard output LED lighted shelves.
- · Nose lights are not available.



SHIPPING WEIGHT				
Case	Weight			
O2.5UM-NRG SUSHI				

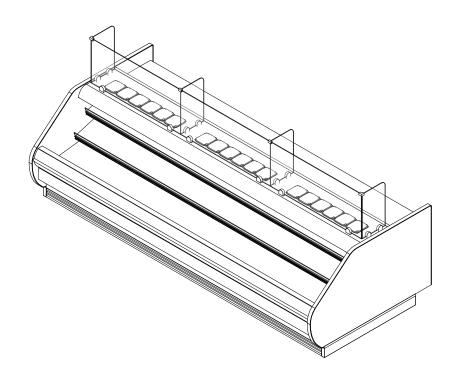





■ COMPONENT

ALL MEASUREMENTS ARE TAKEN PER
ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX
REFRIGERATED DISPLAY CASES FOR SALE IN THE
UNITED STATES MEET OR EXCEED DEPARTMENT
OF EMPENY CASES FOR SALE IN THE OF ENERGY 2017 REQUIREMENTS.

O2.5UM-NRG

Rev. Date	Rev. #	Rev. Title
6-25-20	0	NEW STANDARDS



O2.5UM-NRG

ELECTRICAL DATA								
		High Effic	iency Fans					
Case	Fans Per	120	Volt					
Length	Case	Amps	Watts					
4'	1	0.16	11					
6'	2	0.32	22					
8'	2	0.32	22					
12'	3	0.48	33					

LIGHTING DATA							
		Clearvoyant v4 LED Lighting (Per Light Row)					
		Standard (Cornice			Power ce Only)		
Case	Lights	120 \	/olts	120	Volts		
Length	per row	Amps Watts		Amps	Watts		
4'	1	0.05	5.9	0.12	14.9		
6'	2	0.08	9.4	0.20	23.8		
8'	2	0.10	11.8	0.25	29.8		
12'	3	0.15	17.7	0.37	44.7		

GUIDELINES AND CONTROL SETTINGS								
		BTU	⊣/ft	Superheat Set				
				Point @ Bulb	Evaporator	Discharge	Discharge Air	
Application	Front Sill height	Conventional	Parallel	(°F)	(°F)	Air (°F)	Velocity (FPM)	
Meat	Extended	847	740	6 - 8	26	30	180	

DEFROST CONTROLS								
	Timed-Off Defrost							
Defrosts Per	Fail-Safe	Termination						
Day	(Min)	Temp (F)						
6	30	47						

NOTES:

- "---" indicates that the feature is not an option with this case model and/or the data is not available at this time.
- · Listed BTUH/ft data represent unlighted shelves. For LED lighting, add 9 BTUH/ft per row of lighted shelving.
- · Rear refrigerated box increases refrigeration load by 110 BTUH/ft.
- BTUH load increases by 132 BTUH/ft when aftermarket merchandising accessories are utilized.
- Listed evaporator temperature indicates unlighted shelves. For lighted shelves and/or aftermarket merchandising accessories, reduce the listed evaporator temperature by 2°F.
- Conventional Discharge Air Control Recommended Settings: Cut-In Temp = Discharge Air + 2°F; Cut-Out Temp = Discharge Air 2°F.
- Listed discharge air velocity represents the average velocity at the peak of defrost.
- Temperature and defrost settings listed above are recommended start-up settings. Final operational settings may need to be adjusted for the store conditions in which the case operates.
- The recommended evaporator temperatures may need to be adjusted based on system setup, store conditions, etc. The minimum recommended evaporator temperature is 4°F below the listed evaporator temperature.







O2.5UM-NRG

Rev. Date	Rev.#	Rev. Title
6-25-20	0	NEW STANDARDS



02.5UM-NRG

SECOND NATURE DATA										
	No. of			BTUH/FT		BTUH/FT		GPM/ft	Supply Fluid	Discharge Air
Case Model	Coils	Application	Front Sill height	Conventional	Parallel	(DR)	Temp (°F)	Temp (°F)		
O2.5UM-NRG	1	Bulk Produce	All Fronts	858	750	0.10	20	37		
O2.5UM-NRG	1	Deli/Produce	All Fronts	858	750	0.22	20	31		
O2.5UM-NRG	1	Meat	33" Front	847	740	0.26	20	30		
O2.5UM-NRG	1	Bulk Produce	All Fronts	858	750	0.18	25	37		
O2.5UM-NRG	1	Deli/Produce	All Fronts	858	750	0.56	25	31		
O2.5UM-NRG	1	Meat	33" Front	847	740	0.77	25	30		

SECOND NATURE DATA									
						Timed-C	Off Defrost	Warm Flu	uid Defrost
	No. of			Supply Fluid	No. of	Fail-Safe	Termination	Fail-Safe	Termination
Case Model	Coils	Application	Front Sill height	Temp (°F)	Defrost	(Min)	Temp (°F)	(Min)	Temp (°F)
O2.5UM-NRG	1	Bulk Produce	All Fronts	20	6	60	47	26	49
O2.5UM-NRG	1	Deli/Produce	All Fronts	20	6	60	47	26	49
O2.5UM-NRG	1	Meat	33" Front	20	6	60	47	26	49
O2.5UM-NRG	1	Bulk Produce	All Fronts	25	6	45	42	26	49
O2.5UM-NRG	1	Deli/Produce	All Fronts	25	6	45	42	26	49
O2.5UM-NRG	1	Meat	33" Front	25	6	45	42	26	49

NOTES:


- All medium temperature data listed is for 35% by wt. PROPYLENE GLYCOL.
- · Inhibited Propylene Glycol solution with water, such as Dowfrost or equivalent. (Dowfrost is a trademark of the Dow Chemical Company).
- Flowrates are determined by ASHRAE test conditions and may need to be adjusted based on store conditions.
- ** Flowrates are per case






Rev. Date	Rev.#	Rev. Title
6-25-20	0	NEW STANDARDS



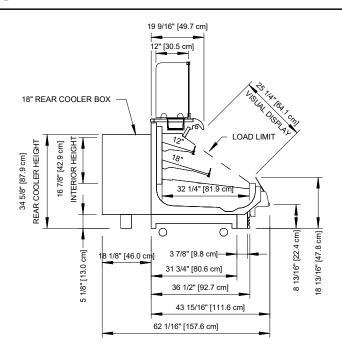

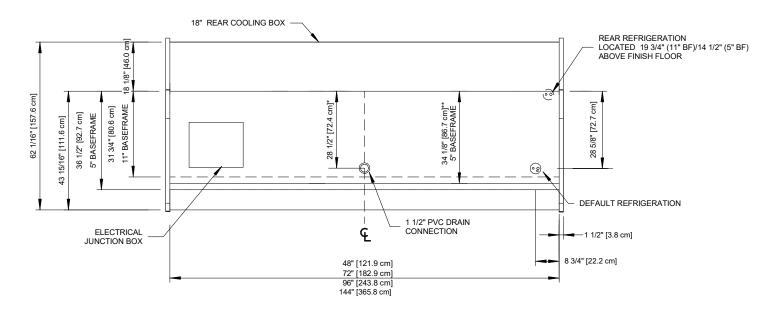

NOTES:

- * :STUB-UP AREA
- ** :RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS
- ① :AVAILABLE SHELF SIZES ARE 10", 12", 14", 16", & 18"
- Ends add approximately 1 inch to case height, 1 inch to the front and 1/2 inch to the back.
- Product on top shelf should be 3 inches below discharge.



O2.5UM-NRG

Rev. Date	Rev.#	Rev. Title
6-25-20	0	NEW STANDARDS



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.